SIEMENS

Product data sheet

3RU1116-0JB0




OVERLOAD RELAY, 0.7...1 A, 1NO+1NC, SIZE S00, CLASS 10, FOR CONTACTOR MOUNTING


General technical details:						
product brand name		SIRIUS				
product designation		thermal overload relay				
Protection class IP / on the front		IP20				
Insulation voltage / with degree of pollution 3 / rated value	V 690					
Installation altitude / at a height over sea level / maximum	m	2,000				
Ambient temperature						
during operating	°C	-20 +70				
during storage	°C	-55 +80				
during transport	°C	-55 +80				
Relative humidity / during operating phase / maximum	%	100				
Resistance against shock		8g / 10 ms				
Impulse voltage resistance / rated value	kV	6				
Active power loss / total / typical	W	6.6				
Item designation						
 according to DIN 40719 extendable after IEC 204-2 / according to IEC 750 		F				
according to DIN EN 61346-2		F				
Operating current / of the fuse link / rated value	А	4				
Trip class		CLASS 10				


	_			
Type of assignement		2		
type of protection		DMT 98 ATEX G 001		
Size of overload relay		S00		
Size of the contactor / can be combined / company-specific		S00		
Protection against electrical shock		finger-safe		
Main circuit:				
Number of poles / for main current circuit		3		
Operating voltage / at AC-3 / rated value				
• maximum	V	690		
Service power / at AC-3				
• at 400 V	kW	0.25		
Adjustable response current				
 of the current-dependent overload release 	А	0.7 1		
Auxiliary circuit:				
Contact reliability / of the auxiliary contacts		acceptability for PLC control (17 V, 5 mA)		
Number of NC contacts		1		
Number of NO contacts		1		
Number of change-over switches		0		
Operating current / of the auxiliary contacts / at AC-15				
• at 24 V	А	3		
• at 110 V	А	3		
• at 120 V	А	3		
• at 125 V	А	3		
• at 230 V	А	2		
• at 400 V	А	1		
Operating current / of the auxiliary contacts / at DC-13				
• at 24 V	А	1		
• at 110 V	А	0.22		
• at 125 V	А	0.22		
• at 220 V	А	0.11		
Short-circuit:				
Design of the fuse link / for short-circuit protection of the auxiliary switch / required		fuse gL/gG: 6 A, quick: 10 A		
Installation/mounting/dimensions:				
Built in orientation		with vertical mounting surface +/-135° rotatable, with vertical mounting surface +/- 45° tiltable to the front and back		
Type of mounting		direct mounting		

mm	87		
mm	45		
mm	78		
-			
mm	0		
_			
mm	0		
mm	6		
_			
mm	0		
mm	6		
	No		
_			
	screw-type terminals		
	screw-type terminals		
	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)		
	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)		
	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)		
	2x (20 16), 2x (18 14), 2x 12		
	mm mm mm mm mm mm mm mm mm mm mm		

 for main contacts 							
• solid		mm²	0.5 4				
 stranded wire 							
 with conductor end processing 		mm²	0.5 2.5				
 for auxiliary contact 							
• solid		mm²	0.5 2.5				
 stranded wire 							
 with conductor end processing 		mm²	0.5 2.5				
AWG number / as coded connectable	conductor cross-section						
 for main contacts / minimum 			20				
 for auxiliary contact 			20 1	4			
Certificates/approvals:							
Verification of suitability					V / DNV / RMRS / RINA /		
		_	PRS//	ABS			
Varification of suitability / ATEX			Yes				
General Product Approval				For use in hazardous locations	Test Certificates		
CQC CSA	ROSTEST			DEKRA EXAM, DMT	Manufacturer		
Shipping Approval							
ABS BUREAU VERITAS		GL		Lloyd's Kegister	PRS		
Shipping Approval	other						
RINA RMRS	Manufacturer						
Further information:							
Information- and Downloadcenter (Catalogs, Brochures,) http://www.siemens.com/industrial-controls/catalogs							
Industry Mall (Online ordering system) http://www.siemens.com/industrial-controls/mall							
CAx-Online-Generator http://www.siemens.com/cax							
Service&Support (Manuals, Certificates, Characteristics, FAQs,) http://support.automation.siemens.com/WW/view/en/3RU1116-0JB0/all							
Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams,) http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3RU1116-0JB0							

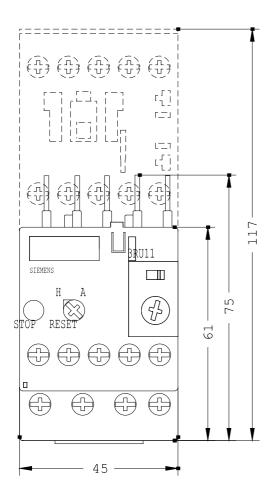

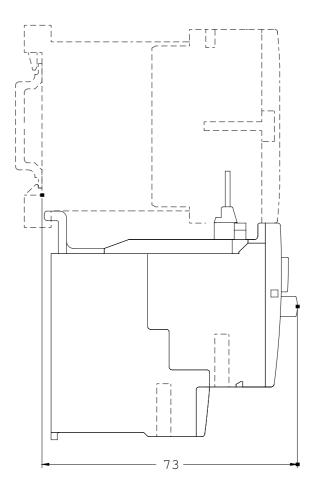

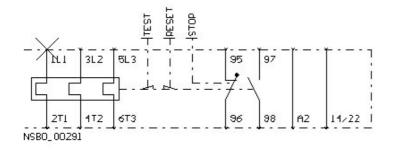

last change:

